


UNDERGROUND POWER SUPPLY

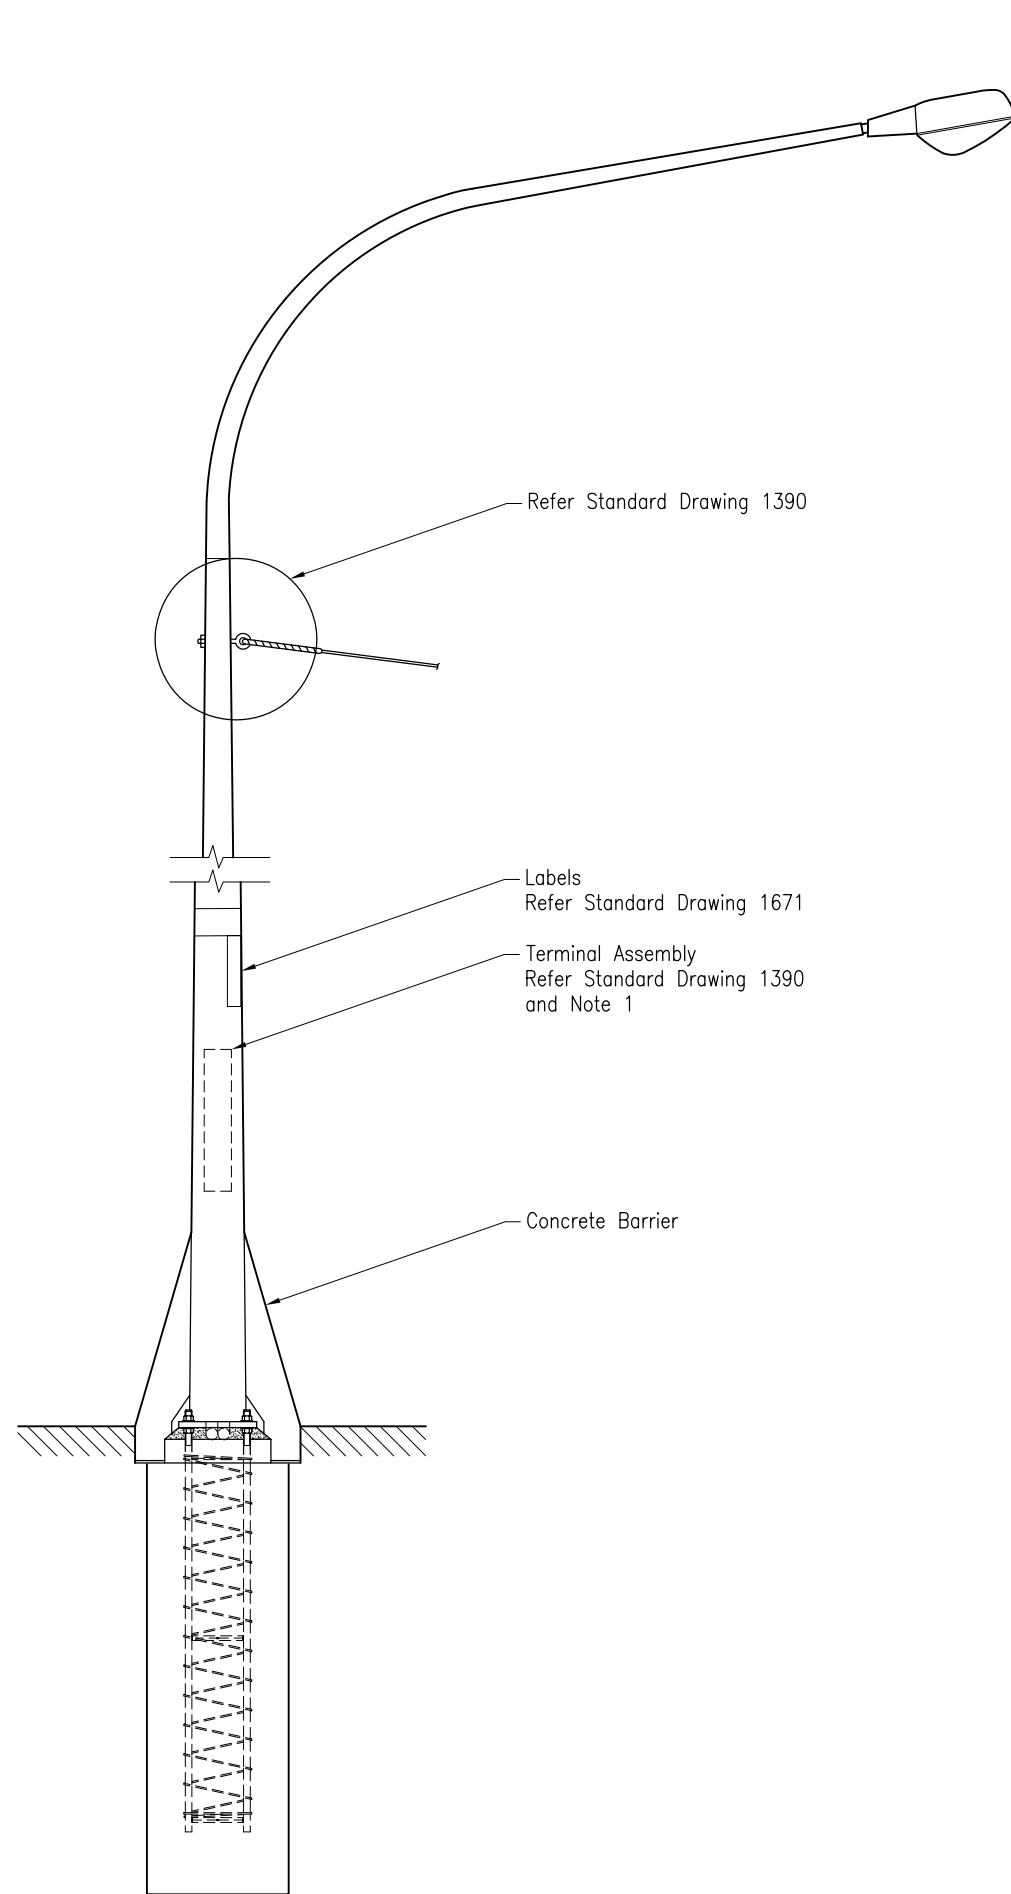

AERIAL POWER SUPPLY

NOTES:

1. Use high hatchway for poles in concrete barriers.

ASSOCIATED DEPARTMENTAL DOCUMENTS:

- Standard Drawings
- Specifications

REFERENCED DOCUMENTS:

Departmental Standard Drawings :



- 1328 Road Lighting – Anchor Cage Fabrication Details
- 1390 Road Lighting – Base Plate Mounted Pole Aerial Connection Wiring Details
- 1395 Road Lighting – Base Plate Mounted Pole and Footing in Concrete Median Barrier Installation Details
- 1431 Road Lighting – Base Plate Mounted Pole Wiring Details for Median Barriers
- 1671 Traffic Signals/Road Lighting – Road Lighting Labels Installation

Departmental Specifications:

- MRTS91 Conduits and Pits
- MRTS94 Road Lighting

Australian Standards:

- AS/NZS 3000 Electrical Installations (Wiring Rules)

Department of Transport and Main Roads		 Queensland Government	 © The State of Queensland (Department of Transport and Main Roads) 2015 http://creativecommons.org/licenses/by/3.0/au
ROAD LIGHTING			
BASE PLATE MOUNTED POLE IN CONCRETE MEDIAN BARRIER		A3	Standard Drawing No
		Not to Scale	1373
			Date 4/15
A	B	C	D
E			