


SECTION A

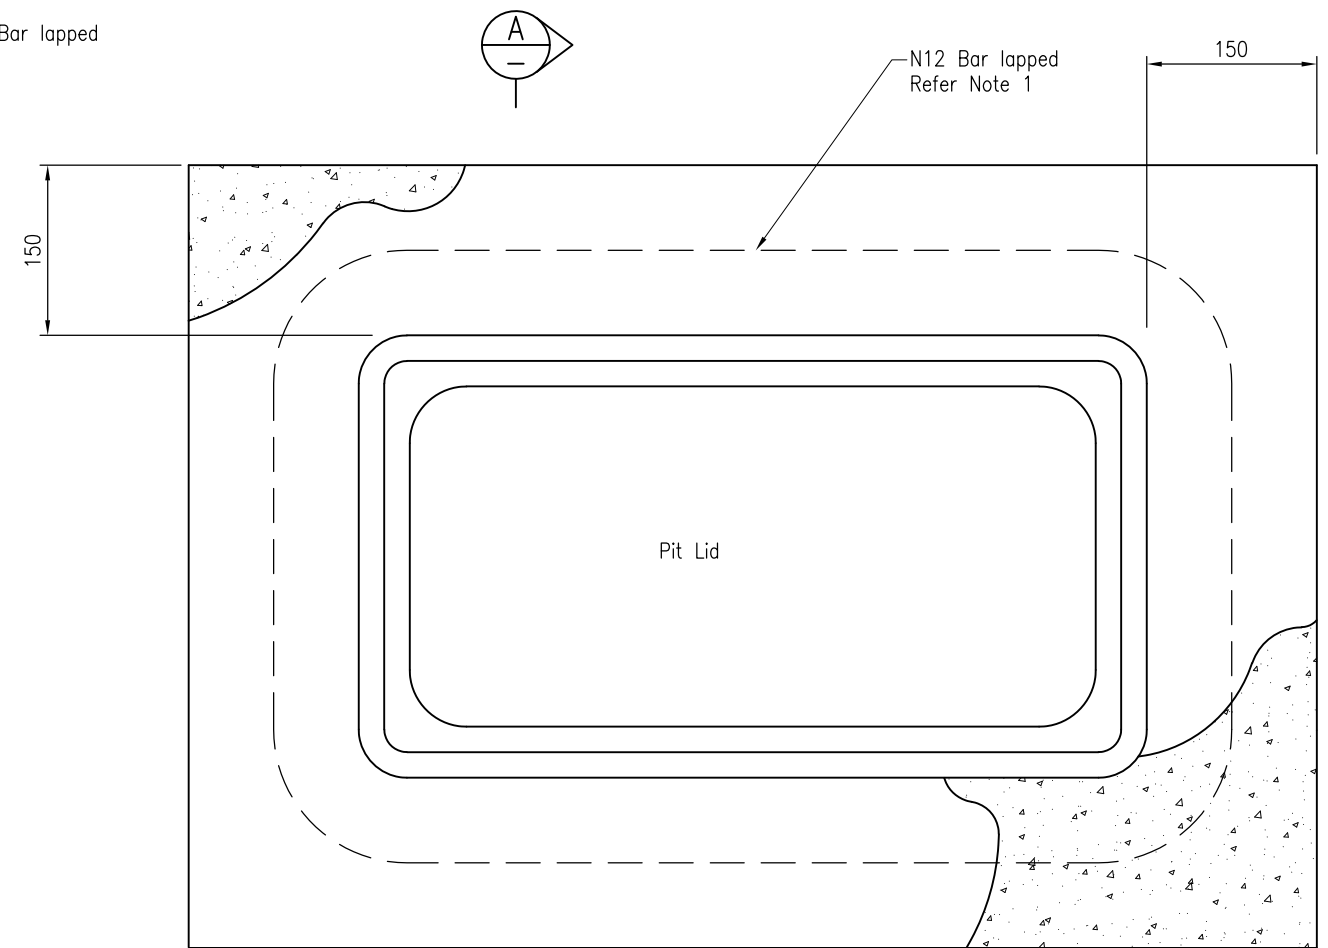

PLAN

NOTES:

1. Install bar centrally in concrete surround
2. Concrete to be N25/20 and shall be in accordance with MRTS70.

ASSOCIATED DEPARTMENTAL DOCUMENTS:

- Standard Drawings
- Specifications

Departmental Specifications:

- MRTS70 Concrete
- MRTS91 Conduits and Pits

Department of Transport and Main Roads		 Queensland Government	 <small>© The State of Queensland (Department of Transport and Main Roads) 2021  <a href="http://creativecommons.org/licenses/by/4.0/">http://creativecommons.org/licenses/by/4.0/</a></small>						
TRAFFIC SIGNALS/ROAD LIGHTING									
CABLE JOINTING PIT RECTANGULAR CONCRETE SURROUND	A3 Not to Scale	Standard Drawing No <b>1440</b> Date 03/2021	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 12.5%; text-align: center;">A</td> <td style="width: 12.5%; text-align: center;">B</td> <td style="width: 12.5%; text-align: center;">C</td> <td style="width: 12.5%; text-align: center;">D</td> <td style="width: 12.5%; text-align: center;">E</td> <td style="width: 12.5%; text-align: center;">F</td> </tr> </table>	A	B	C	D	E	F
A	B	C	D	E	F				