




TYPICAL PLAN  
INSTALLED SIDE INLET GULLY

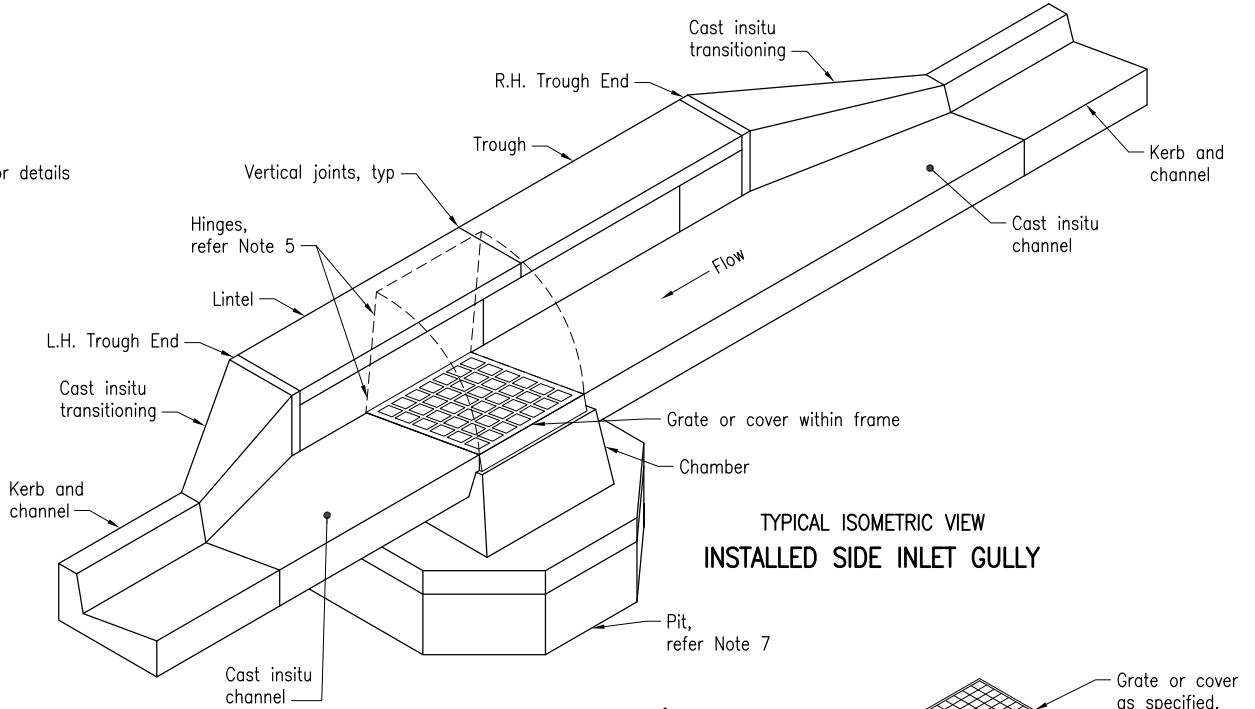


TYPICAL ISOMETRIC VIEW  
INSTALLED SIDE INLET GULLY




SECTION




PLAN - GRATE shown in left flow situation.  
For right flow, rotate grate through 180°  
TYPICAL VANED GRATE  
(Bicycle Safe)

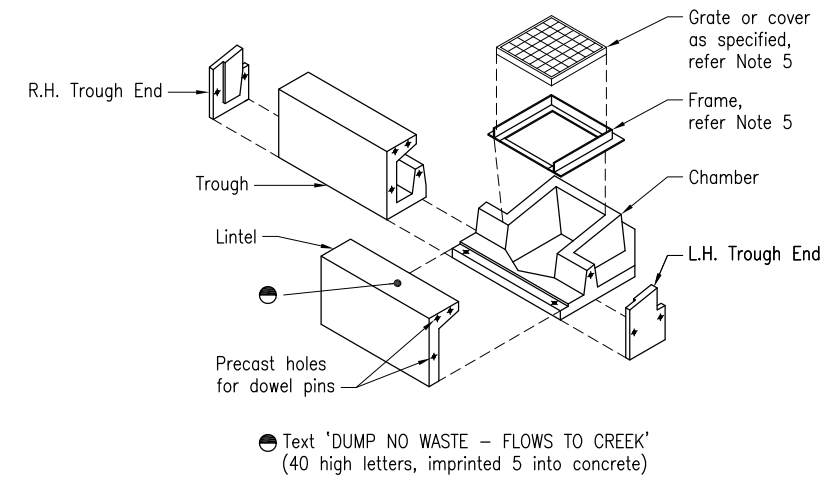


TYPICAL PRECAST COMPONENT ASSEMBLY

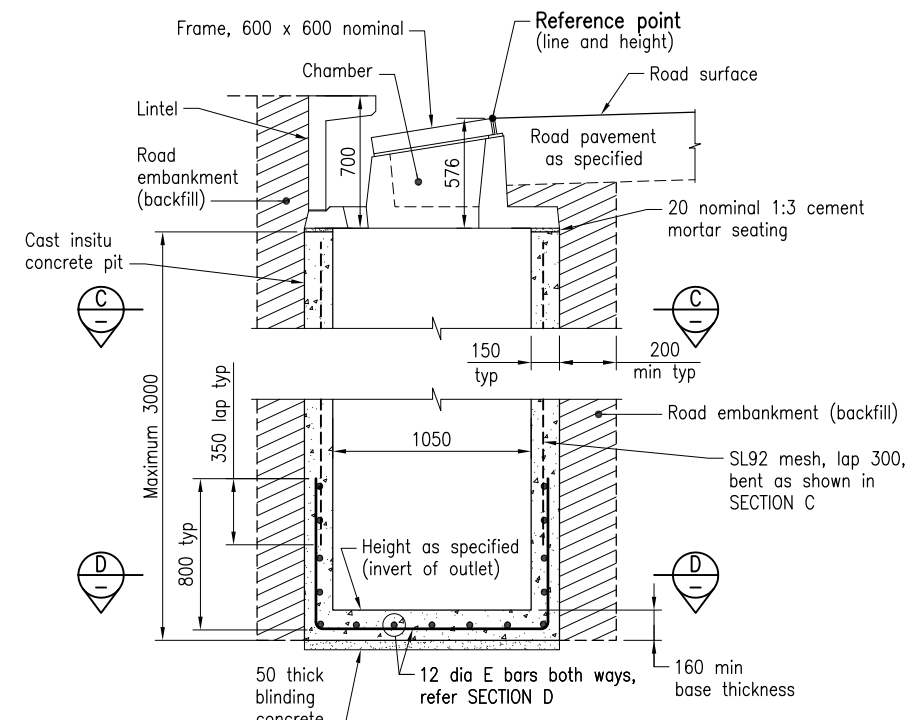


SECTION A

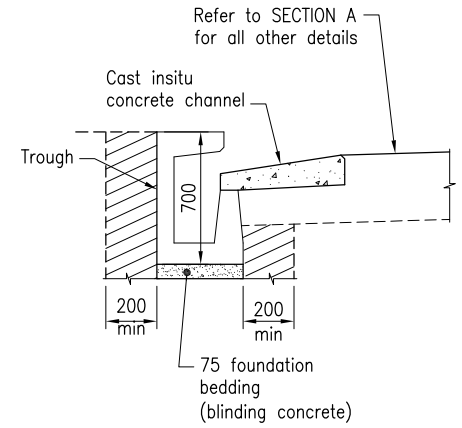

SECTION B

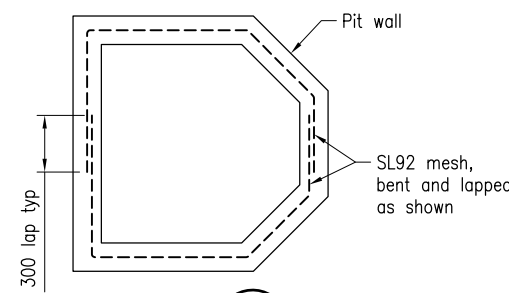

SECTION C  
PLAN OF PIT WALL REINFORCEMENT

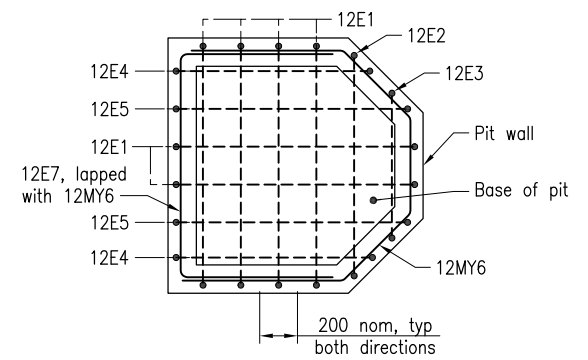

SECTION D  
PLAN OF BASE AND LOWER PIT WALL REINFORCEMENT

**NOTES:**

- SCOPE: This Standard Drawing provides details of concrete side inlet gully with cast insitu pit of maximum depth 3000. Pit sizes greater than those shown on this drawing shall be a project specific design. Constructability and accessibility of deeper pits shall be considered in the design. Refer Note 11 for additional design requirements for pits deeper than 5000. If the gully is on a curved kerb alignment project specific design shall be required. Refer Standard Drawing 1321 for precast concrete side inlet gully with precast shaft.
- CONCRETE SIDE INLET GULLIES shall be in accordance with MRTS03.
- DESIGN LIFE: Pits up to 5000 deep - 50 years for all components.
- DESIGN OF CONCRETE COMPONENTS:
  - Traffic loads and traffic load surcharge shall be in accordance with AS 5100.
  - Load factors and load combinations shall be in accordance with AS 5100.
  - Structural design shall be in accordance with AS 3600.
- GRATES, COVERS AND FRAMES shall be Class D to AS 3996. Bicycle safety testing of grates and covers shall be in accordance with AS 3996. Hinged grates and covers are to be provided with a positive mechanical retainer to secure them firmly in place when in the open position. Double hinge system shall be provided for grates designed to accept flow from one direction. Approved grates, covers and frames shall be used.
- CONCRETE shall be in accordance with MRTS70. Concrete pit and chamber S32/20. Concrete channel S32/10. Blinding concrete S20/20. Exposure classification B1 to AS3600. Minimum cover to reinforcement shall be 40 unless shown otherwise. All exposed edges shall have 19 x 19 chamfers unless shown otherwise.
- REINFORCING STEEL shall be read in conjunction with Standard Drawings 1043 and 1044. Reinforcing steel shall be in accordance with MRTS71 and AS/NZS 4671. Deformed bars Grade D500N and mesh Grade D500L. All reinforcing steel shall be ACRS certified.
- CONSTRUCTION OF PIT - The plane of the top of the pit shall be constructed as follows:
  - Level when measured at right angles to the line of lip of channel
  - To the same grade as the lip of channel when measured parallel to the line of lip of channel.
- PRECAST COMPONENTS shall be in accordance with MRTS72. Installation, doweled connections and vertical joints shall be in accordance with manufacturer's specifications. Precast components shall be connected by means of dowel pins. These pins shall be manufactured from either T220 minimum grade grey cast iron to AS 1830 or grade 250 steel bar to AS/NZS 3679.1 and hot-dipped galvanized to comply with the requirements of AS/NZS 4680.
- PROJECT-SPECIFIC INFORMATION TO BE SHOWN IN THE DOCUMENTS: Reference Point; Height of pit; Connecting pipe details; and Steel schedule
- DESIGN REQUIREMENTS for pits deeper than 5000:
  - Design life 100 years;
  - Minimum exposure classification B2 to AS 5100;
  - Minimum concrete strength S40/20 for pit; and S32/10 for channel;
  - Cover to reinforcement to AS 5100.
 Concrete components shall be designed for loading as specified in Note 4.
- DIMENSIONS are in millimetres unless shown otherwise.

ASSOCIATED DEPARTMENTAL DOCUMENTS:

- Design Criteria for Bridges and Other Structures
- Road Drainage Manual

REFERENCED DOCUMENTS:

- Departmental Standard Drawings:
- 1033 Kerb and Channel - Kerbs, Channels and Ramped Vehicular Crossing
  - 1043 Reinforcing Steel - Standard Bar Shapes
  - 1044 Reinforcing Steel - Lap Lengths

Departmental Specifications:

- MRTS03 Drainage, Retaining Structures and Protective Treatments
- MRTS70 Concrete
- MRTS71 Reinforcing Steel
- MRTS72 Manufacture of Precast Elements

Department of Transport and Main Roads		 <small>© The State of Queensland (Department of Transport and Main Roads) 2016 http://creativecommons.org/licenses/by/3.0/au</small>
<b>CONCRETE GULLY</b>		
<b>PRECAST CONCRETE SIDE INLET GULLY WITH CAST INSITU PIT</b>		Standard Drawing No <span style="font-size: 2em; font-weight: bold;">1322</span> Date 7/16
A3	Not to Scale	
A	B	C